



CODE INFORMATION SHEET

Based on the 2015 edition of the Vermont Fire and Building Safety Code, NFPA 101 and NFPA 1

STAIR REQUIREMENTS

Requirements of the Vermont Fire and Building Safety Code

Standard Stairs NFPA 101 - 7.2.2.2.1

Stairs shall meet the following criteria:

New stairs shall be in accordance with Table 7.2.2.2.1.1(a).

Existing stairs shall be permitted to remain in use, provided that they meet the requirements for existing stairs shown in Table 7.2.2.2.1.1(b).

Approved existing stairs shall be permitted to be rebuilt in accordance with the following:

- (a) Dimensional criteria of Table 7.2.2.2.1.1(b)
- (b) Other stair requirements of 7.2.2.2.1.1(b)

In one and two family dwellings the maximum riser heights of 7 ¾ in. and minimum tread depths of 10 in. shall be permitted in new construction. [Vermont Amendment to 24.2.5.7]

Within any individual dwelling unit, unless protected by an approved automatic sprinkler system, stairs more than one story above or below the entrance floor level of the dwelling unit shall not be permitted. [30.3.1.3]

Spiral stairs complying with the life safe code shall be permitted within a single dwelling unit. [30.2.2.3.3]

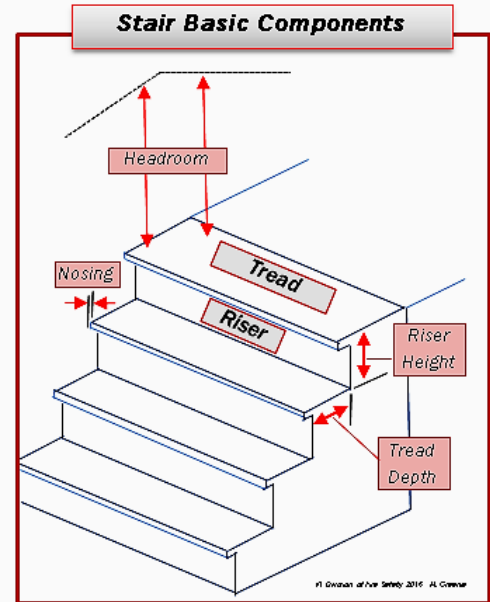


Table 7.2.2.2.1.1(a) New Stairs

Feature	Dimensional Criteria
Minimum width clear of all obstructions except projections not more than 114 mm (4½ in.) at or below handrail height on each side	44 in. (36 in. where total occupant load of all stories served by stairways is fewer than 50)
Maximum Height of Risers	7 in.
Minimum Height of Risers	4 in.
Minimum Tread Depth	11 in.
Minimum Headroom	6 ft. 8 in.
Maximum Height Between Landings	12 ft.
Landing	See Life Safety Code

Table 7.2.2.2.1.1(b) Existing Stairs

Feature	Dimensional Criteria
Minimum width clear of all obstructions except projections not more than 114 mm (4½ in.) at or below handrail height on each side	36 in.
Maximum Height of Risers	8 in.
Minimum Tread Depth	9 in.
Minimum Headroom	6 ft. 8 in.
Maximum Height Between Landings	12 ft.
Landing	See Life Safety Code